


Natural Shower™

Performance Data Sheet

This system has been tested according to NSF/ANSI 177 standards for reduction of free available chlorine. The concentration of free available chlorine in water entering the system was reduced to a concentration less than or equal to the permissible limit for water leaving the system, as specified in NSF/ANSI 177 standards. This system has not been evaluated for free available chlorine reduction performance in the presence of chloramines. Free available chlorine reduction performance may be impacted by the presence of chloramines in the water supply. Please contact your local water utility to determine if chloramines are used in treating your water.

Natural Shower Test Results

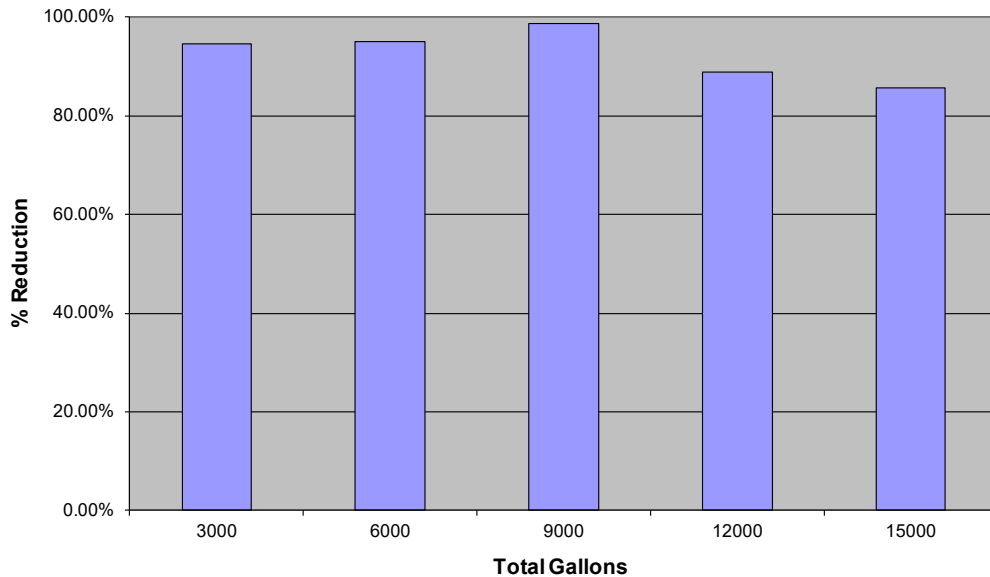

Sample Point (gallons)	Influent Chlorine (mg/l)	Effluent Chlorine (mg/l) and % Reduction				
		Unit 1	Unit 1 %	Unit 2	Unit 2 %	Average %
0 (Initial)	2	0.6	70.00%	0.46	77.00%	73.50%
3000	2.2	0.13	94.09%	0.11	95.00%	94.55%
6000	2	0.13	93.50%	0.07	96.50%	95.00%
9000	2.1	ND	100.00%	0.05	97.62%	98.81%
12000	2.1	0.19	90.95%	0.28	86.67%	88.81%
15000	2.1	0.23	89.05%	0.37	82.38%	85.72%
18000	1.9	0.36	81.05%	0.37	80.53%	80.79%
21000	2.2	0.39	82.27%	0.58	73.64%	77.96%
24000	1.9	0.62	67.37%	0.49	74.21%	70.79%
27000	1.9	0.65	65.79%	0.92	51.58%	58.69%

Naturally Filtered, LLC
PO Box 1866
Alachua, FL 32616

Toll-Free: 800-428-9419
Tel: 386-462-0563
Fax: 386-462-0817



Natural Shower Performance Data Sheet

NOTES:

1. While testing was performed under standard lab conditions, actual performance may vary.
2. Do not use with water that is microbiologically unsafe or of unknown quality without adequate disinfection.
3. Filter life will vary in proportion to the amount of water used and the level of impurities in the water being processed. For optimum performance, it is essential that the filter be replaced on a regularly scheduled basis as follows: (a) every 12 months; (b) every 15,000 gallons; (c) when the flow rate diminishes.
4. The Natural Shower is warranted as follows: All parts, workmanship and materials - 1 year. Please see the Owner's Manual for complete product guarantee and warranty information.
5. Please see the Owner's Manual for installation instructions and operating procedures.
6. Check for compliance with state and local laws and regulations.



Natural Shower Technical Specifications	
Filtration Media	KDF 55/85, 50 Micron Polyethylene Pre-filter
Maximum Flow Rate	2.5 gpm (9.5 lpm)
Pressure Range	20 - 100 psi (1.38 - 6.89 bar)
Rated Cartridge Life	15,000 gallons (56,700 liters) or 12 Months
Operating Temperatures	40° - 120° Fahrenheit (5° C - 49° C)
System Dimensions/Weight	6.7" x 3.75" (17 x 9.5 cm) 14.5 oz (0.41 kg)
Cartridge Dimensions/Weight	4.75" x 2.65" (12 x 6.7 cm) 11 oz (0.31 kg)
Product Warranty	One year for workmanship & material defects

Naturally Filtered, LLC
PO Box 1866
Alachua, FL 32616

Toll-Free: 800-428-9419
Tel: 386-462-0563
Fax: 386-462-0817

